


TYPICAL SECTION

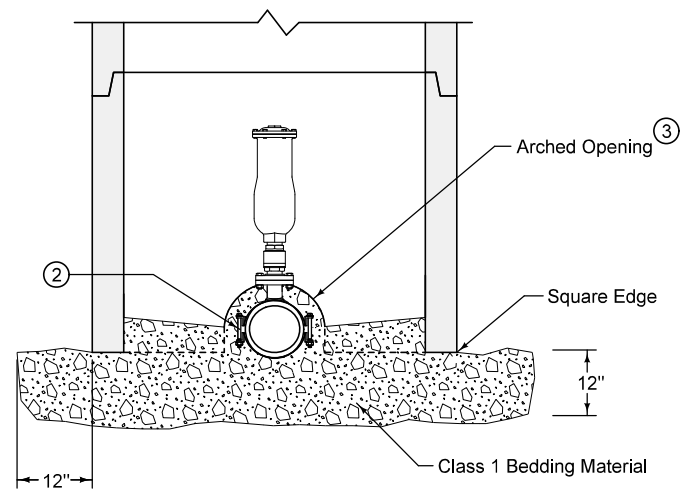

SECTION A-A

- ① SW-601 Type A or SW-602 Type G casting.
- ② Place bedding material to springline of pipe.
- ③ Prevent riser from bearing on pipe by providing an arched opening with a diameter up to 6 inches larger than pipe diameter.

FIGURE 4010.202 SHEET 1 OF 1

| | | |
|--|--------------------|--|
| SUDAS | IOWADOT | REVISION |
| | | 1 04-17-18 |
| FIGURE 4010.202 | STANDARD ROAD PLAN | SW-202 |
| | | SHEET 1 of 1 |
| <small>REVISIONS: Replaced Iowa DOT and SUDAS logos.</small> | | |
| <i>Paul D. Wigand</i> <small>SUDAS DIRECTOR</small> | | <i>Brian Smith</i> <small>DESIGN METHODS ENGINEER</small> |
| SEWAGE AIR RELEASE VALVE PIT | | |