
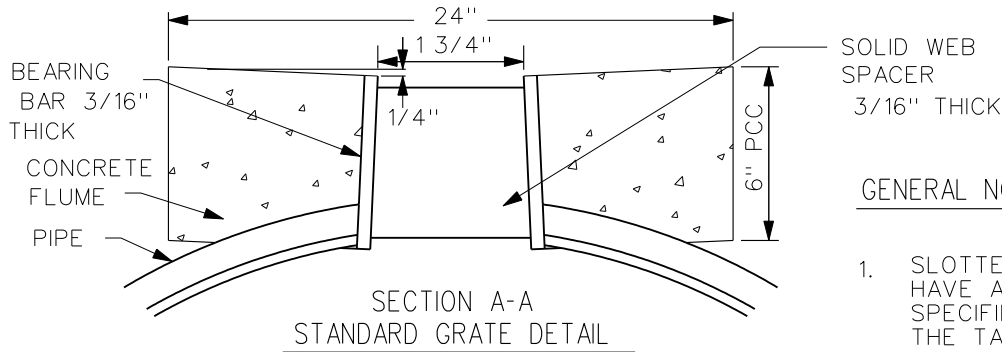


THIS IS AN ARCHIVED FIGURE AND IS NO LONGER MAINTAINED AS PART OF THE SUDAS STANDARD SPECIFICATIONS. THIS FIGURE MAY CONFLICT WITH THE CURRENT SPECIFICATIONS, AND SECTION AND FIGURE REFERENCES MAY NO LONGER BE VALID.

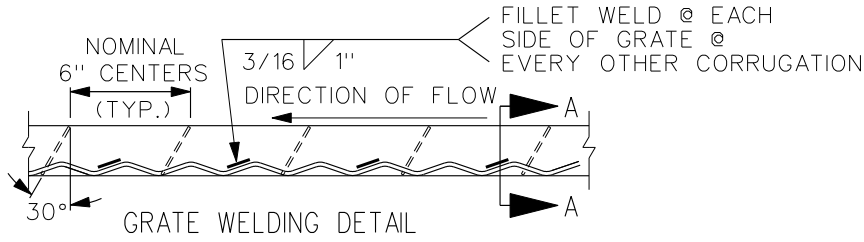


GENERAL NOTES


1. SLOTTED DRAIN PIPE SHALL HAVE A WALL THICKNESS AS SPECIFIED ON THE PLANS FROM THE TABLE BELOW:

TABLE NO. 1

| PIPE SIZE | AVAILABLE GAUGES | | |
|-----------|------------------|--------|--------|
| | 16 GA. | 14 GA. | 12 GA. |
| 12 | X | X | |
| 15 | X | X | |
| 18 | X | X | |
| 24 | X | X | |
| 30 | X | X | X |
| 36 | X | X | X |

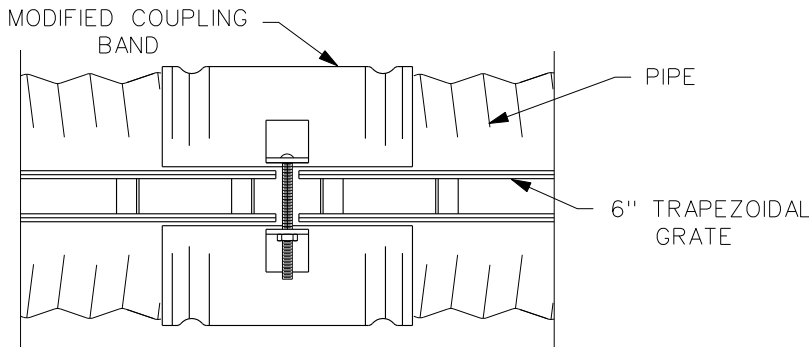


MODIFIED COUPLING BAND TOP VIEW

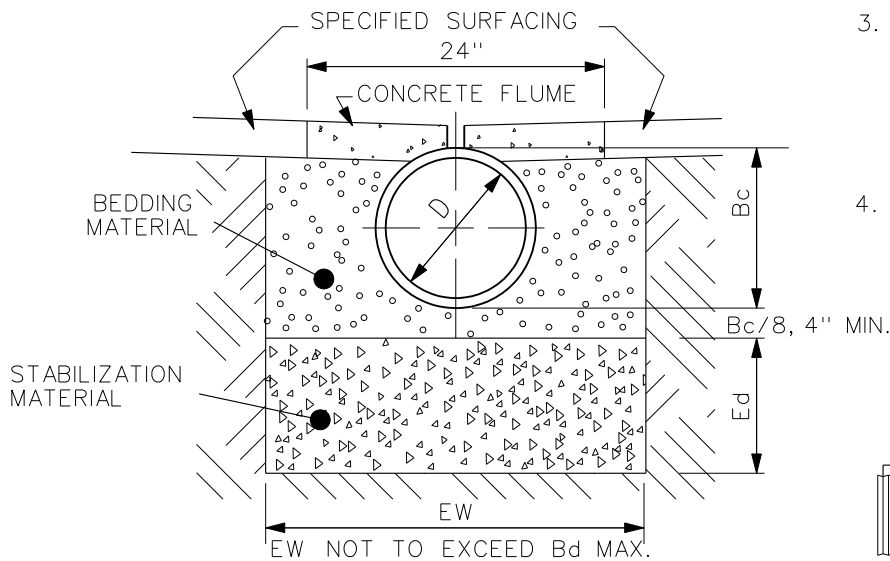

DITCH SECTION

2. STRUCTURAL STEEL SHALL CONFORM TO ASTM A36.
3. B_d = TRENCH WIDTH AT TOP OF PIPE.
 - a. MAXIMUM TRENCH WIDTH:
 $B_d = B_c + 12"$
 - b. MINIMUM TRENCH WIDTH:
 $B_d = 1 1/4 B_c$
4. STABILIZATION MATERIAL WHEN REQUIRED SHALL BE PLACED BELOW NORMAL BEDDING.

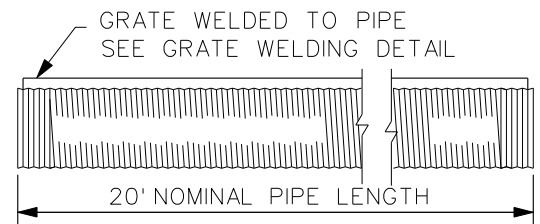

TYPICAL PIPE SECTION